


Notes:

- All Concentrations are in Micrograms per Liter (ug/l)
- Concentrations Highlighted in Bold Exceed the New York State Ambient Water Quality Standards or Guidance Values for Class GA Groundwater Provided in the NYSDEC Division of Water Technical and Operational Guidance Series (I.1.1), Dated June 1998, and the April 2000 Addendum.

Abbreviations:
 1,1-DCE 1,1-Dichloroethene
 cis-1,2-DCE cis-1,2-Dichloroethene
 trans-1,2-DCE trans-1,2-Dichloroethene
 MC Methylene Chloride
 TCE Trichloroethene
 VC Vinyl Chloride
 ND Compound Not Detected Above Laboratory Reporting Limits
 J Estimated Concentration

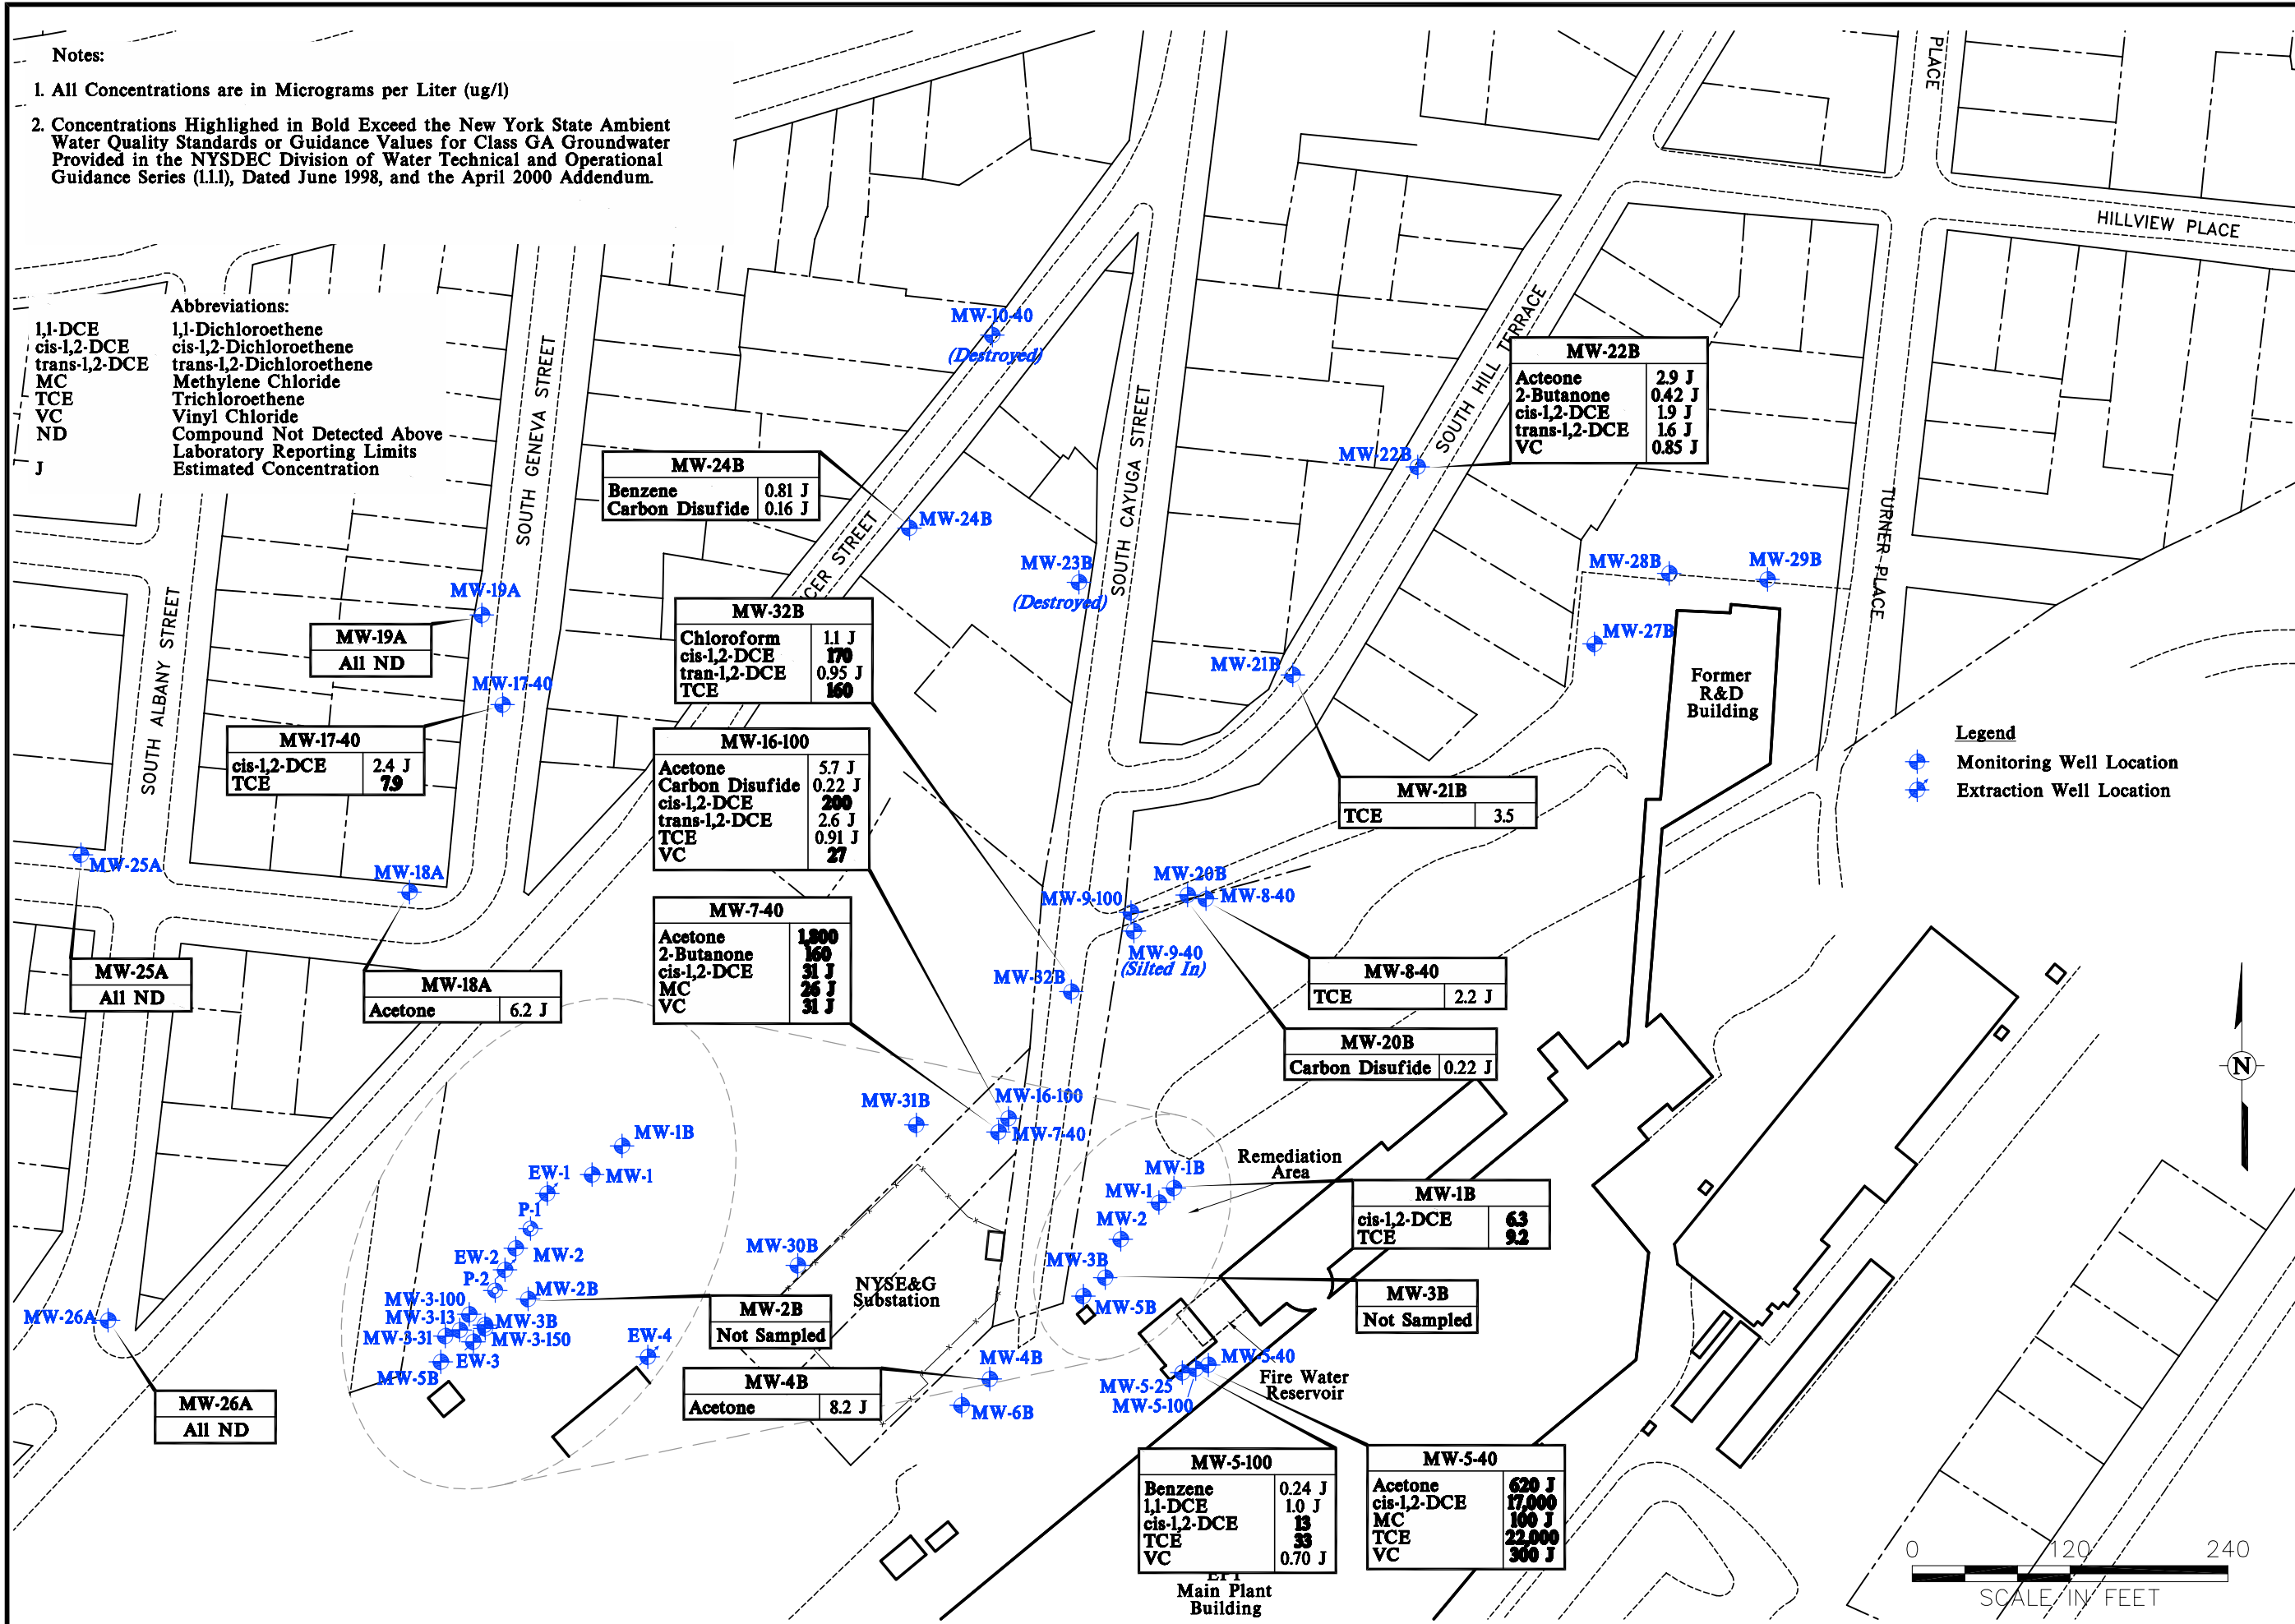

Drawn By: JME

Checked: ESR

Approved: TMM

DWG Name: 127491308

EMERSON POWER TRANSMISSION
 ITHACA, NEW YORK
 PREPARED FOR
 EMERSON POWER TRANSMISSION

FIGURE 8
 SITE-WIDE GROUNDWATER SAMPLING RESULTS
 (OCTOBER 2007)

WSP
 ENGINEERING OF
 NEW YORK, P.C.
 11190 SUNRISE VALLEY DRIVE, SUITE 300
 RESTON, VIRGINIA 20191 (703) 709-6500

